


Charging System Maintenance overview

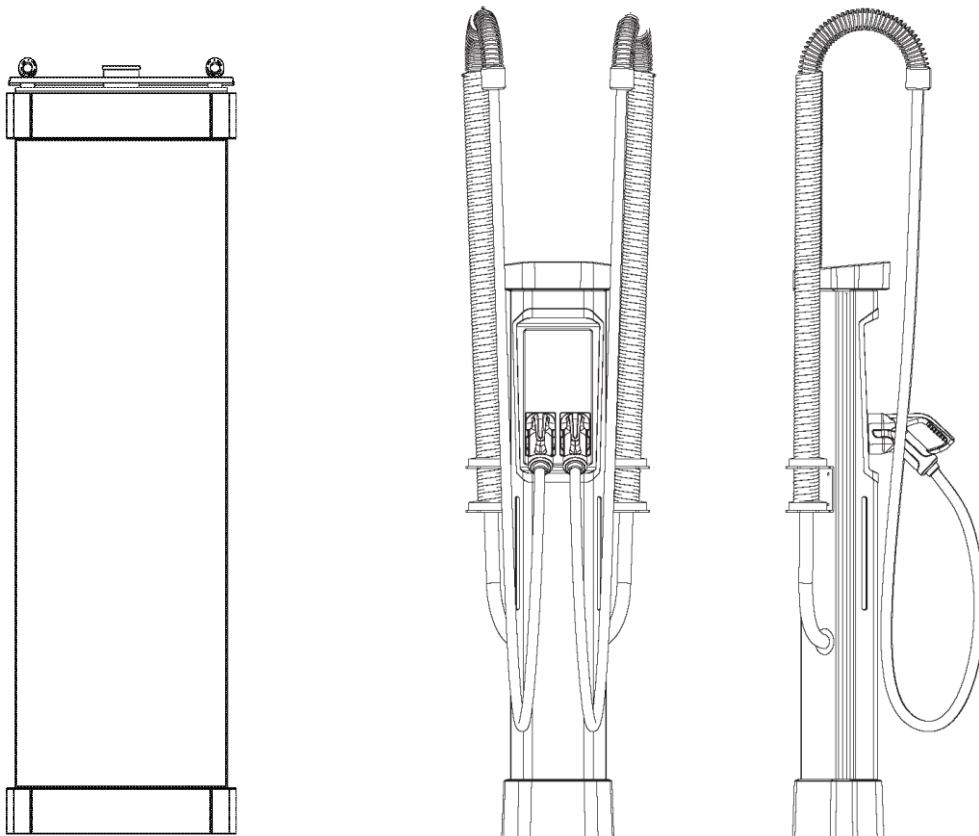

The following preventive maintenance actions must be carried out regularly.

Charging Power Unit / Satellite	Annually	Per request	After 10.000 uses
C-Series Maintenance	•		
Air filter	•	•	
Charging cable plug		•	•
Charging cable		•	
Software update		•	

• = Perform

Performing preventive maintenance tasks (•) is only allowed to be performed by personnel who have completed Kempower certification training for charger maintenance. The maintenance interval always depends on environmental conditions and specific application.

Ask more information from your local authorized Kempower service partner or request authorization service training to your team.

- C-Series CPU Maintenance
 - To be carried out annually, and more often in demanding conditions. Maintenance tasks include e.g. visual inspection, cleaning and tightening terminal connections.
- Air filter
 - To be maintained annually, according to the preventive maintenance plan.
- Charging cable
 - To be replaced if any damage observed. Inspect regularly.
- Charging cable plug
 - To be replaced after 10.000 insertion cycles, or if any damage observed.
- Software update
 - Software update is performed per request.